


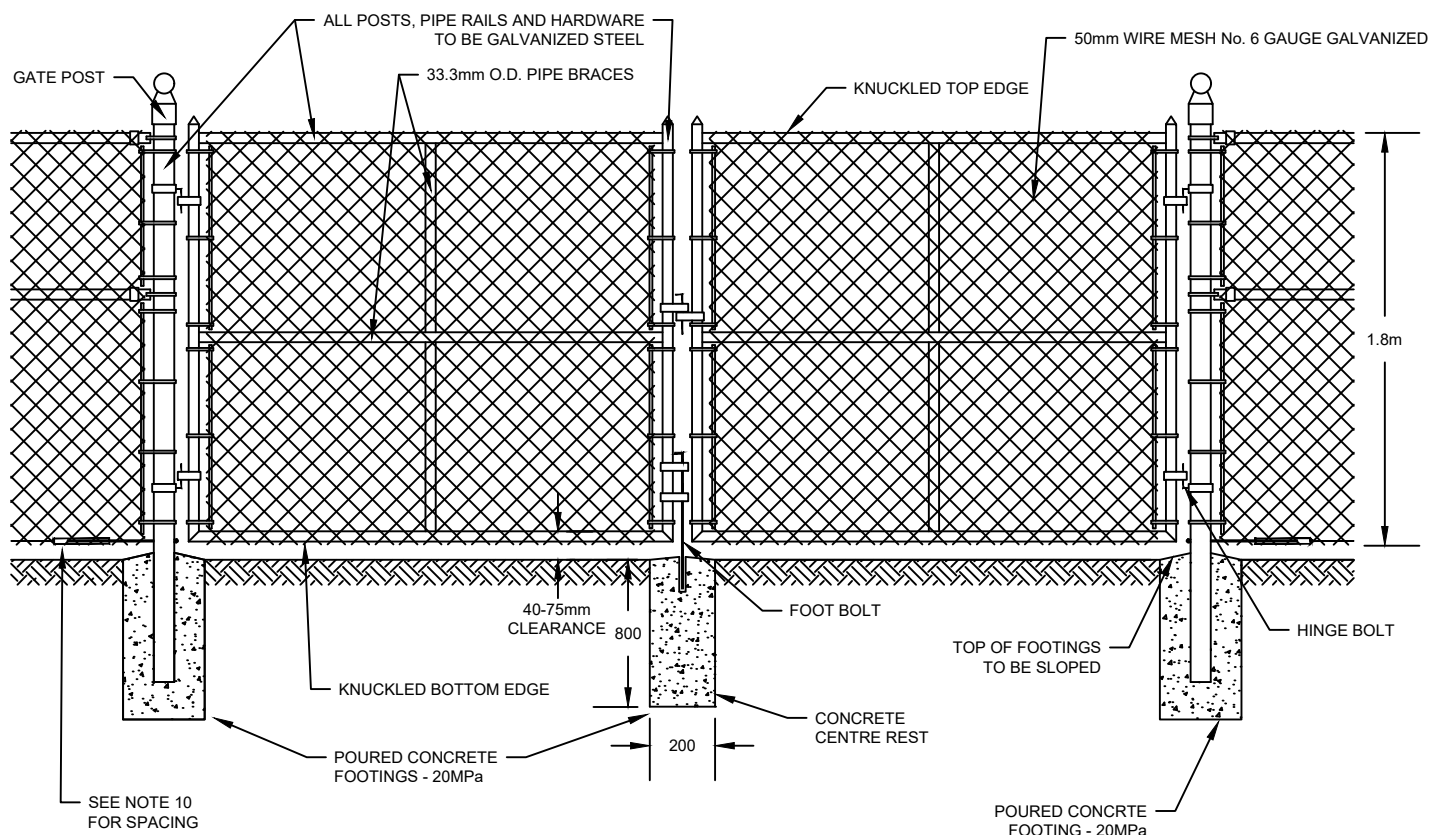

NOTES

1. THIS STANDARD TO BE READ IN CONJUNCTION WITH C-501.
2. WIRE MESH TO BE ON PUBLIC SIDE OF GATE.
3. GATE FRAME TO BE CONSTRUCTED OF 42.8mm O.D. GALVANIZED STEEL PIPE.
4. GATE TO OPEN ONTO PRIVATE PROPERTY.
5. ALL HARDWARE AND GATE FRAME TO BE GALVANIZED SCHEDULE 40.
6. ALL WIRE FASTENERS TO BE 6 GAUGE ALUMINUM, OR HEAVIER
7. FRAME MEMBERS AND BRACES ARE TO BE WELDED.
8. GATE POSTS ARE TO BE 3.0m IN LENGTH.
9. SONOTUBES ARE TO BE USED FOR ALL FOOTINGS.
10. MAXIMUM 50mm GAP FROM CHAIN LINK FENCE TO GRADE BENEATH

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED

Clarington

GALVANIZED STEEL CHAIN LINK DOUBLE GATE

REVISION NO.: 1

REVISION DATE: DECEMBER 2025

C-503B